



23665

Models 7981/ES7981




Control Box

Installation Instructions



For closer information see closer installation instruction sheet

Typical Electric & Air Supply Hook Up

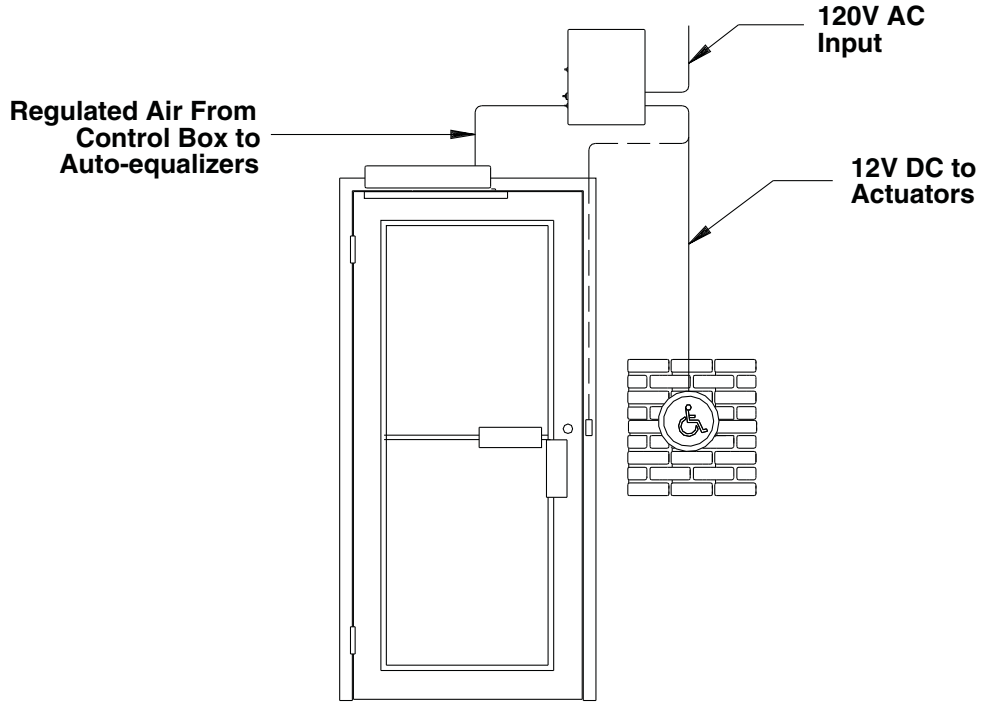

Installation

<p>1a Locate box on interior of building within 50 tubing feet of the door to be controlled. Box must be in a clean, dry, well ventilated place where temperatures do not exceed 120°F or fall below 35°F.</p>	<p>1f Air pressure output has been preset at factory. If more air pressure is required to adequately open door, regulate air adjustment valve on pump, as shown on page 3.</p>
<p>1b Mount box to a structurally sound surface using screws provided as shown on page 2 with air fittings on left side as shown. Do not mount box upside down or on a horizontal plane.</p>	<p>1g Adjust time delay to keep air valve energized by turning adjustment wheel on timer modules "A" (CW to increase - CCW to decrease). The LED (light) on the timer module indicates the valve is energized. The time can be adjusted from 0-30 seconds. 10 seconds is a "normal" delay.</p> <p>ⓘ NOTICE: Timer Module "A" must operate longer than Timer Module "P".</p>
<p>1c Refer to instructions packed with actuators and connect leads to terminals 8, 9, and 10 as required.</p>	<p>1h Adjust timer module "P" to keep compressor activated for the necessary amount of time to open the door. This can be done by rotating the adjusting wheel. (CW to increase - CCW to decrease). The LED (light) on the timer module indicates the compressor is energized. The compressor should not run more than 1-3 seconds longer than the time required to open the door.</p>
<p>1d Connect unpowered 120V AC input to terminals 3, 4, and ground screw. (Line side to terminal 3, neutral side to terminal 4 and ground wire to ground screw.) If door control is on a fire door, 120V AC input must be interrupted by the fire alarm panel when in alarm. When dry auxiliary fire alarm contacts are used, remove shunt from terminals 1 and 2 and connect to dry contacts of fire detector or alarm panel. Terminals 1 and 2 are in series with line side of 120V input.</p>	<p>1i Test actuators to insure wiring and tubing are properly connected.</p>
<p>1e Turn on power. Air valves and compressor will operate one cycle when power is applied.</p>	

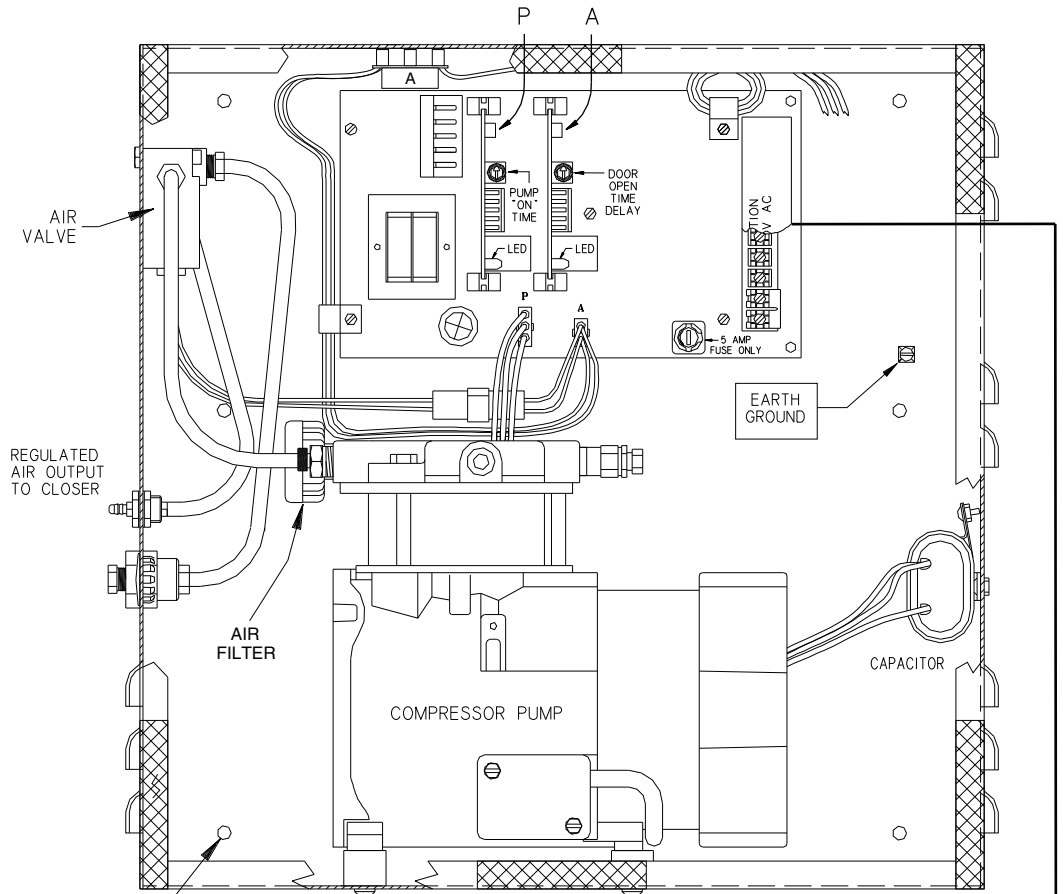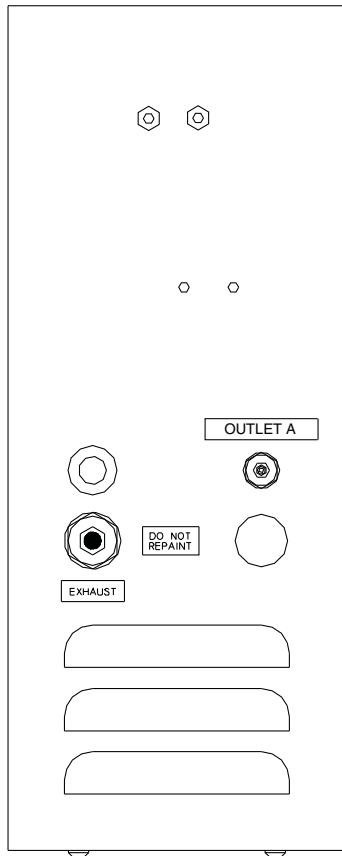

CAUTION

DO NOT MOUNT BOX UPSIDE DOWN OR IN HORIZONTAL POSITION. LOCATE WHERE TEMPERATURES DO NOT EXCEED 120°F OR FALL BELOW 35°F

CAUTION

COMPONENTS INSIDE CONTROL BOX WILL BE HOT TO TOUCH UNDER NORMAL OPERATION. ALLOW BOX TO COOL DOWN BEFORE MAKING ADJUSTMENTS.

WARNING



HAZARDOUS VOLTAGE CAN SHOCK AND CAUSE SEVERE INJURY


Disconnect power before making any electrical connections or performing maintenance.

Install Box With Six Tapcon Concrete Screws 3/16 X 1 1/4 Drill 5/32 Hole 1 1/4 Deep With Carbide Tipped Concrete Drill Bit

Air Filter Should Be Inspected Every Six Months. If Filter Is Damaged, contact LCN For Replacement.

ELECTRICAL DATA

Input = 120V AC @ 5 amps
Power consumption 600 watts
Output is 12V DC (250 ma max. Load)


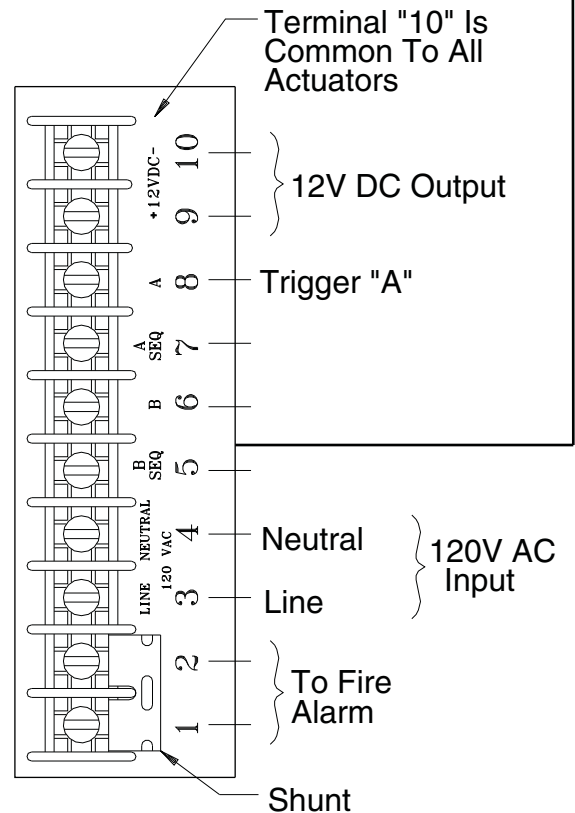


* Remove This Shunt Only When Connecting To Normally Closed Fire Alarms Contacts

DANGER

Control Box **MUST** be connected to earth ground

Air Pressure Adjustment

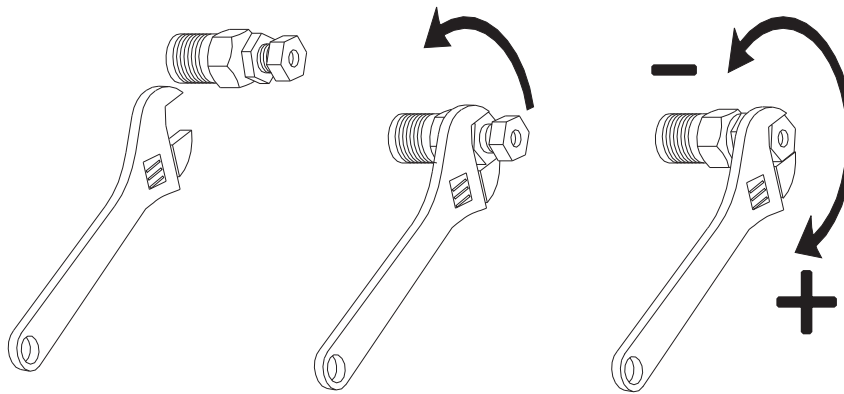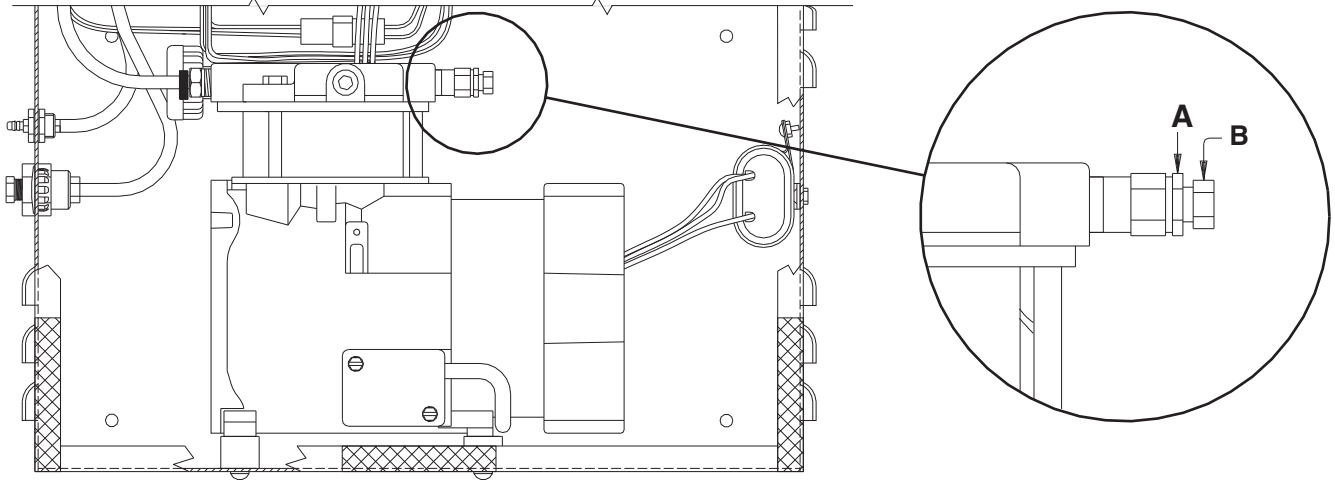

Air Pressure Adustment

- 1a Loosen lock nut.(A)
- 1b Turn outer valve (B) to regulate air pressure.
- 1c Tighten lock nut.


Installation Troubleshooting Chart

Symptom	Possible Cause	Suggested Remedy
No Power Opening	No power to control box / blown fuse	Verify 120VAC 60HZ power is present at terminals 3 & 4 on control box terminal strip. Check fuse. Replace only with 5 amp (3AG type) fuse.
	Actuator(s) not connected properly	Be sure a timer module board is firmly in place in "A" & "P" slots. Operate actuator(s). LED on timer module should light when actuator is used. The LED on timer "P" should light whenever "A" is lit. If not, momentarily short actuator terminals 8 & 10 in the control box. If LED lights, check wiring to actuators for an open circuit. If it does not light, check for voltage at terminals 9 & 10. Voltage should read from 11.75 to 13.25V DC. If there is no reading, disconnect leads from terminals 9 & 10. Short actuator terminals 8 & 10. If LED lights, check for short circuit in actuators.
	Fire alarm system causing open circuit on terminals 1 & 2	Shunt terminals 1 & 2 with power off. Restore power. If control operates when actuator terminals 8 & 10 in the control box are shorted, an open circuit exist in wiring to fire alarm. When Auto-Equalizer is not used with fire alarms, terminals 1 & 2 must be permanently shorted with a shunt. IMPORTANT! When Auto-Equalizer is connected to fire alarm, make sure shunt is removed from terminals 1 & 2. Terminals 1 & 2 are one leg of 120V line.
	No input to Auto-Equalizer operator	Disconnect tubing from Auto-Equalizer operator. Try actuator and verify that air is coming out of tubing. If not, trace tubing to control box, checking for breaks or kinks in air line.
	Air lines obstructed with dirt or ice.	Clean or thaw lines and reroute if necessary. Eliminate dips near cold zones.
	Air valves not working	Make sure air valve leads are plugged into main board. (Be sure valves in system are plugged into connector "A".)
	Compressor not working	Make sure compressor leads are plugged into main board. (Be sure compressor is plugged into connector "P").
Does not open or fully open	Control box exhaust restricted.	Exhaust muffler may be clogged by dirty air or accidental painting. Clean in alcohol or mineral spirits.
Opens too slow or not at all	Inlet filter clogged	Replace filter element (Contact LCN for replacement)

Symptom	Possible Cause	Suggested Remedy
Power opening will not time out.	Scanner maintaining signal to control box.	Make sure lenses are clean and there are no obstructions in front of scanner. Model 909 or 939 proximity scanner may "see" an opposite wall. Adjust range as described earlier.
	Switch circuit maintaining contact.	Check for short circuit or error in wiring to switch or scanner.
	Air valve blocked open with contaminant.	Cycle valve several times by momentarily shorting actuators in the control box. This should clear valve.
Power opening timing out too soon.	Air compressor needs readjustment.	See page 2 for regulation instructions.
	Timer cards not set properly	Set timer cards "A" for Max. time. Set timer card "P" for Min. time. Slowly increase card "P" until "time-out" is 1-3 seconds after door is fully open. Decrease timer card "A" to achieve desired time delay before closing. (Make sure "P" times out before "A".)

Model ES7981 For Use with Electric Latching Hardware

Es7981 - 1 Electric Strike Maximum

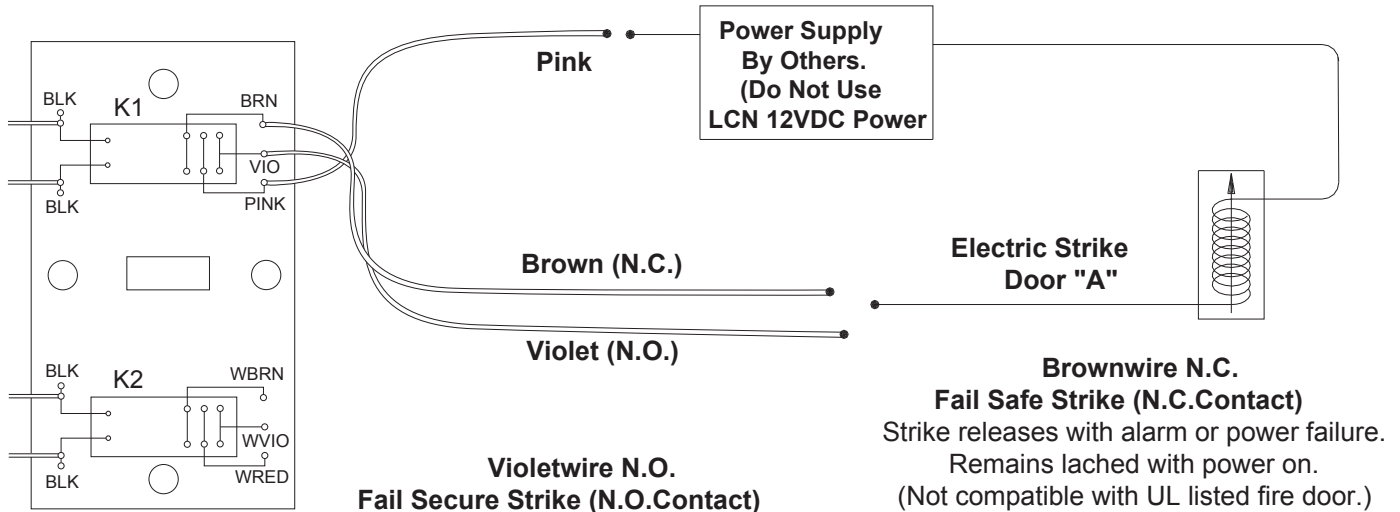

⚠ WARNING

HAZARDOUS VOLTAGE CAN SHOCK AND CAUSE SEVERE INJURY

Disconnect power before making any electrical connections or performing maintenance.

Customer Service

1-877-671-7011 www.allegion.com/us



© Allegion 2014
Printed in U.S.A.
23665 Rev. 01/14-e